



# ■ Infrared Fixture Integrated Sensor For High Bay Light BRI819P-C-D Instruction

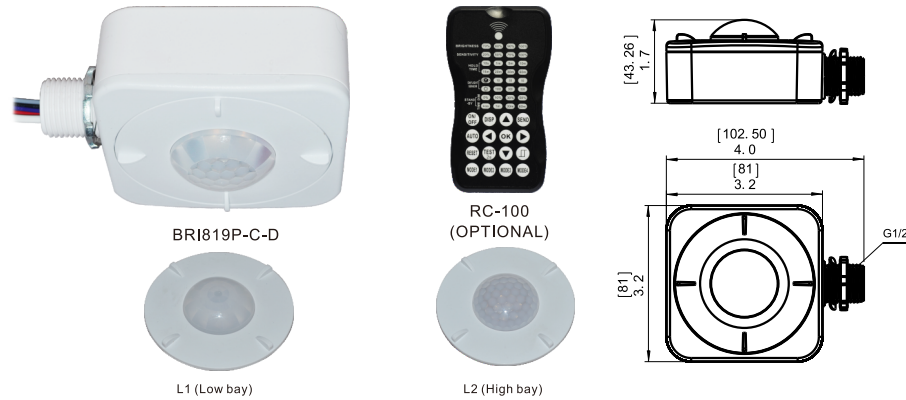


# ■ Infrared Fixture Integrated Sensor For High Bay Light BRI819P-C-D Instruction

## SENSOR INFORMATION

### L1 Len

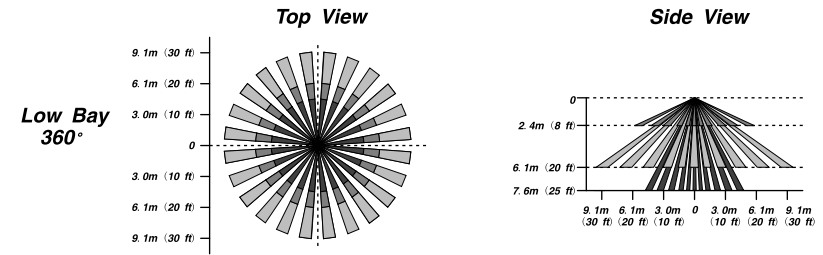


### L2 Len

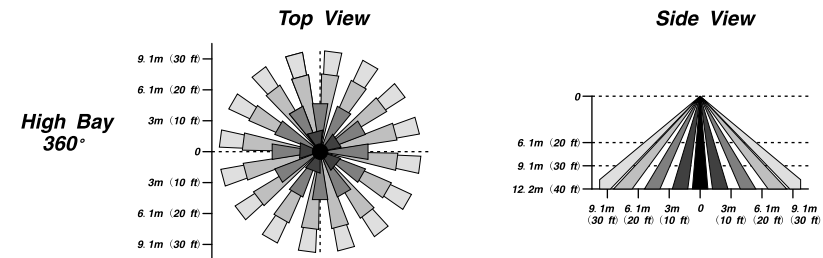

## FUNCTION AND OPTIONS

The microwave sensor to achieve tri-level dimming control, for same areas that require a light change notice before switch off.

It offers 3 levels of the light Control : 100%--dimming light (0,10%,30%,50%)--off;and 2 periods of selectable waiting time: motion hold-time and stand-by time. Selectable daylight threshold and choice of detection area.

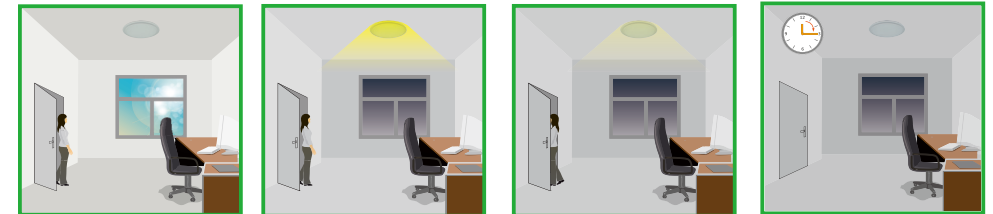

With sufficient natural light, the light does not switch on when presence detected.

With insufficient natural light, the sensor switches on the light automatically when person enters room.

People left, light still dims to 0/10%/30%/50% (options) standby level after the hold time.

Light switches off automatically after after stand-by time elapsed.

## INTRODUCTION

The BRI819P-C-D mounts in an indoor lighting fixture and provides multi-level control based on motion . It controls 0-10 VDC LED drivers or dimming ballasts.

The BRI819P-C-D occupancy sensors are designed to mount to a light fixture and control one load in that fixture. They can be wired to control all ballasts in the fixture, or to control half of the ballasts, providing high/low lighting control. When motion is detected within the sensor's coverage area, the relay in the sensor closes, and lighting loads are automatically turned on.

## SPECIFICATIONS

Power supply	120-347VAC 50/60Hz
Maximum load @ -40°F ~ +167°F (-40°C ~ +75°C)	Resistive/Halogen - 800W@120V/1200W@277V/1500W@347V Fluorescent Ballast - 660VA@120V/1200VA@277V/1500VA@347V Electronic Ballast (LED/CFL) - 5A@120V/5A@277V/5A@347V
Dim control output	0-10V, max. 25mA sinking current
PIR Len L1	30ft@25ft height/360
PIR Len L2	30ft@40ft height/360
Time setting	10sec.-15min.(adjustable)
Light-control	10-50Lux (adjustable)
Humidity	Max. 95% RH
Temperature	-40°F ~ +167°F (-40°C ~ +75°C)

## ⚠ WARNING

**NOTE:** Warm up time is 40seconds. After the sensor connects input power first time, the light will keep on 40seconds,then go to dimming to work normally.


**NOTE:** Factory Default Setting: 100% sensitivity, Hold on time: 10seconds, Daylight sensor is 30lux, Dimming level:30%,Dimming time: 60minutues.

**NOTE:** Any setting changed by DIP Switch or remote control, the led light that sensor connect will on/off as confirm.

# ■ Infrared Fixture Integrated Sensor For High Bay Light BRI819P-C-D Instruction

## PARAMETER SETTING BY DIP SWITCH

Consider the picture: 1, 2 set sensitivity; 3, 4 set hold time; 5, 6 set the lux; 7, 8 stand-by light level ; 9, 10 set stand-by time ;

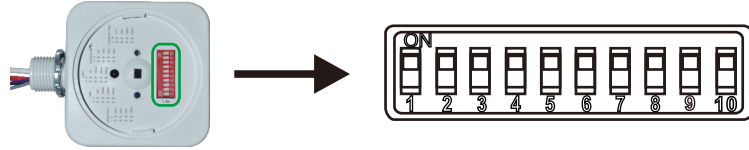

## Detection Range Setting (sensitivity)

Detection range is the term used to describe the radii of the more or less circular detection zone produced on the ground after mounting the sensor light at a height of 40ft(L2), pull switch to the ON position as "↑", pull switch to the OFF position as "↓", switch location and detection range of the corresponding table is as follows:

SENSITIVITY		1	2
ON	↑	↓	↓
		↓	↑
		↑	↓
OFF	↓	↑	↑

SENSITIVITY: 1, 2

## Hold Time Setting

The light can be set to stay ON for any period of time between approx. 10sec and a maximum of 15min. Any movement detected before this time elapse will re-start the timer. It is recommended to select the shortest time for adjusting the detection zone and for performing the walk test. Pull switch to the ON position as "↑", pull switch to the OFF position as "↓", switch location and hold time of the corresponding table is as follows:

TIME		3	4
ON	↑	↓	↓
		↓	↑
		↑	↓
OFF	↓	↑	↑

TIME: 3, 4

## Light-control Setting

The chosen light response threshold can be infinitely from approx. 10-50lux, pull switch to the ON position as "↑", pull switch to the OFF position as "↓", switch location and light-control of the corresponding table is as follows:

LIGHT		5	6
ON	↑	↓	↓
		↓	↑
		↑	↓
OFF	↓	↑	↑

LIGHT: 5, 6

# ■ Infrared Fixture Integrated Sensor For High Bay Light BRI819P-C-D Instruction

## Stand-by Light Level Setting

Switch to the on is "↑", switch to the off is "↓"; The corresponding file of switch location and stand-by level as follow:

STAND-BY LEVEL		7	8
ON	↑	↓	↓
		↓	↑
		↑	↓
OFF	↓	↑	↑

STAND-BY LEVEL: 7, 8

## Stand-by Time Setting

Switch to the on is "↑", switch to the off is "↓", The corresponding file of switch location and stand-by time setting as follow:


STAND-BY TIME		9	10
ON	↑	↓	↓
		↓	↑
		↑	↓
OFF	↓	↑	↑

STAND-BY TIME: 9, 10

## PARAMETER SETTING BY REMOTE CONTROL IN MANUAL OF RC-100.

## WIRING DIAGRAMS

### Dimming Driver

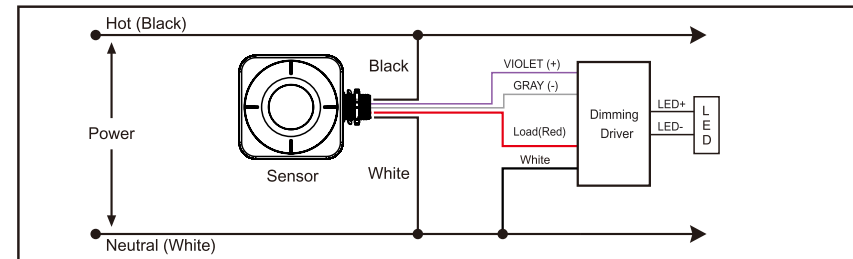

### Non-Dimming Driver

